


SHK[®]
PPR Pipes & Fittings

**MOST EFFICIENT
PIPING SYSTEM**

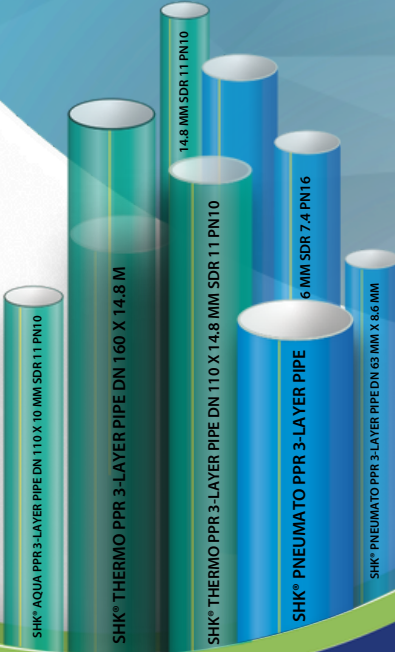

COMPANY PROFILE

This is an era of transforming our utilization by using the most efficient products. So, with an aim of providing more sustainability in the field of pipes and fittings which plays a very vital role in the quality & safety purpose, SHK POLYMER INDUSTRIES, a trustable brand and a leading Manufacturer of PPR-C Pipes & Fittings and HDPE Pipes & Fittings, are here to provide you the best manufactured pipes using the Raw Material procured from the most reliable sources in the world.

SHK Polymers Industries is an ISO 9001:2008 certified company having an experience of more than 40 years. We provide a wide range of PPR-C pipes in terms of Size (16 mm to 400 mm) and in terms of Pressure (PN 6 to PN 20) as per IS- 15801:2008 and all the Fittings are manufactured as per DIN 15962. SHK Polymers Industries has a phenomenal Manufacturing Facility for PPR-C Pipes & Fittings which are currently the best replacement of any kind of pipes for Hot/Cold Water Supply, Compressed Air, Chemical Supply & Clean Water Supply.

SHK Polymers Industries are also into the manufacturing of HDPE Pipes which are quite in demand for Water Supply, Effluent Supply, Drainage applications, Chemicals Supply & Casing over Electrical Cables. SHK HDPE Pipes are according to the standards of IS 4984 sizing from 20 mm to 450 mm in all the grades and Pressure Ratings mentioned in Indian Standards.




Infrastructure

We have with us well developed infrastructure facilities that include advanced technology based machinery and a Specialized Research & Development Unit. We have Multiple Extrusion and Injection Moulding Units for PPR-C and HDPE Pipes & Fittings. This helps us to achieve columninous and qualitative production. Our plant is equipped with the most sophisticated & advance machineries to manufacture the products conforming to the standards laid down by Indian and International standard requirements and well equipped with in-house Testing & Quality Assurance Facilities.

SHK PPR-C PIPES



Upper Layer - UV Stabilized

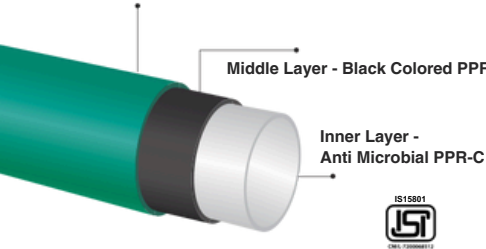


Anti-microbial PPR-C Inner Layer Anti-Microbial Layer Prevents the growth of Bacteria/Algae/Microbes etc inside the pipe which makes suitable for the Usage of any Clean Water or Liquid Food Supply Application.



UV Stabilized PPR-C Top layer:

1. UV Stabilizers contains various chemical properties, which gives the protection against UV light by various chemical mechanisms.
 2. Colors like Black, Green already have good resistance to UV rays, but addition of UV stabilizers further enhance the light and
 3. thermal stability of product.
- UV stabilizers impart long term durability and enhance life of the product.

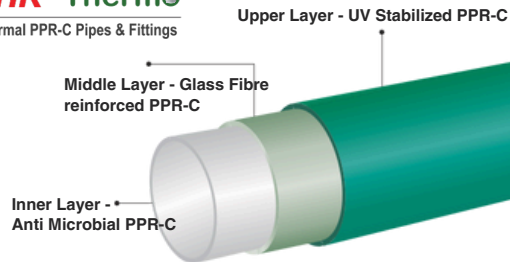

Properties

- Wide Operating Temperature range: (-8) to 95 Degree Celsius
- Lighter in Weight
- Longer Service Life
- Leak Proof (Socket-Fusion Joining)
- Non-Scaling
- Very low Thermal Conductivity (0.23 W/mK)
- Very Low Frictional Factor (1.5 Ft / 100 Ft)
- No Electrical Conductivity
- Anti-Corrosive
- Good Chemical Resistance
- Negligible Heat Loss
- Low Laying Time
- Recyclable Material

Fields of Application

- Hot/Cold Water Supply
- Chemical Plants
- Cooling Towers & Condensor Lines
- Chilled Water Supply
- Pharmaceutical Industries (USFDA Approved)
- Effluent/ Water/Sewage Treatment Plants
- RO Drinking Water Plant
- Solar Water Heater
- Fire Application



Available Colors



SHK PNEUMATIC PPR-C PIPES & FITTINGS


SHK Flame Retardant Pipes

The Outer-most Layer of PPR-C pipes is added with Flame Retardant Additives like UL94 to get protection against the fire and helps to stop the flame within some seconds.

SHK® Pneumato
Pneumatic PPR-C Pipes & Fittings

UL 94 FLAME RETARDANT CHARACTERISTIC

TEST CRITERIA	UL94 (TESTING AS PER IEC 60707)
Burning time of each individual test specimen (s) (after first and second flame applications)	≤30
Total burning time (s) (10 flame applications)	≤250
Burning and afterglow times after second flame application (s)	≤60
Dripping of burning specimens (ignition of cotton batting)	Yes
Combustion up to holding clamp (specimens completely burned)	No

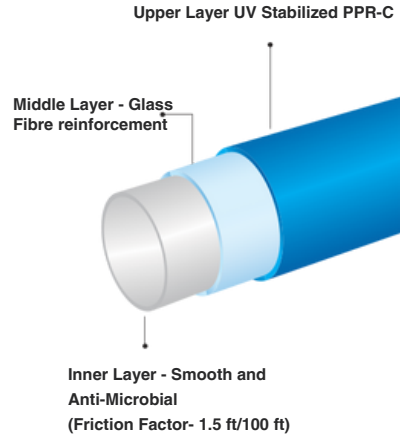

Application

- Compressed Air
- Instrument Air
- Vacuum Air
- Nitrogen Air



Available Colors



**MOST ENERGY SAVING PIPES
FOR ALL AIR APPLICATIONS**



STANDARD SIZES OF PPR-C WITH WALL THICKNESS

SHK PPR-C Pipes are ISI approved following the IS: 15801:2008. Below is the thickness requirements as per standards of Sizes and Pressure Ratings.

OUTER DIAMETER	MS PIPE SIZING	SIZE DETAILS ACCORDING TO INCH	SDR11/PN10			SDR7.4/PN16			SDR6/PN20		
			THICKNESS	INNER DIAMETER	KG/Meter	THICKNESS	INNER DIAMETER	KG/Meter	THICKNESS	INNER DIAMETER	KG/Meter
20	15 MM	1/2"	1.9	16.2	0.	2.8	14.4	0.148	3.4	13.2	0.172
25	20 MM	3/4"	2.3	20.4	107	3.5	18	0.230	4.2	16.6	0.266
32	25 MM	1"	2.9	26.2	0.	4.4	23.2	0.370	5.4	21.2	0.434
40	32 MM	1 1/4"	3.7	32.6	164	5.5	29	0.575	6.7	26.6	0.671
50	40 MM	1 1/2"	4.6	40.8	0.	6.9	36.2	0.896	8.3	33.4	1.040
63	50 MM	2"	5.8	51.4	261	8.6	45.8	1.410	10.5	42	1.650
75	65 MM	2 1/2"	6.8	61.4	0.	10.3	54.4	2.010	12.5	50	2.340
90	80 MM	3"	8.2	73.6	412	12.3	65.4	2.870	15	60	3.360
110	100 MM	4"	10	90	0.	15.1	79.8	4.300	18.3	73.4	5.010
160	150 MM	6"	14.6	130.8	638	21.9	116.2	9.040	26.6	106.8	10.600
200	200 MM	8"	18.2	163.6	1.	27.4	145.2	14.180	34	132	17.150

010

1.

410

OUTER DIAMETER	MS PIPE SIZING	SIZE ACCORDING TO INCHES	SDR17/ P N6			SDR13.6/ P N8			SDR11/ P N10		
			THICKNESS	INNER DIAMETER	KG/Meter	THICKNESS	INNER DIAMETER	KG/Meter	THICKNESS	INNER DIAMETER	KG/Meter
200	200 MM	8"	11.4	177.	7.05	14.7	170.	8.27			
250	250 MM	10"	14.2	6	10.940	18.4	6	13.300	22.7	204.	15.
315	300 MM	12"	17.9	221.	17.572	23.3	213.	21.190	28.6	6	528
400	350 MM	16"	23.5	6353	28.060	2			257.	24.	

279.

9.

268.

8

683

Note : SDR Means Standard Dimensional Ratio which is THE RATIO OF OUTER DIAMETER WITH THE THICKNESS OF THE PIPES.

920



Thermal Properties

Properties	Test Method	Unit	Value
Thermal Conductivity at 23 C	DIN 52612	W/m0k	0.23
Specific heat at 23 C	Calorimeter	Kj/kg0K	1.73 1.5
Coefficient of linear thermal expansion	DIN 53752	K-1	x 10 44.4
Under weight deformation temperature 1.8 N/mm2	ISO 306	°C	42 130
0.45 N/ mm2	ISO 3146		
VICAT softening point	0.095	°	

Mechanical Properties

Properties	Test Method	Unit	Value
Tensile Stress at Yield (50mm / minute)	ISO 527-1,2	MPa	24
Tensile Stress at Yield (50mm / minute)	ISO 527-1,2	%	10
Tensile modules (secant)	ISO 527-1,2	MPa	850
Flexural Modulus	ASTM D 790	MPa	850
Tear Strength	ISO 527	MPa	40
Elongation at tear	ISO 527	%	800
Shore D Hardness	DIN 53 505	-	65
Pipe Friction Factor	-	-	0.007
CHARPY Impact Strength	23°C	ISO 179/leA	KJ/m ² 22
	0°C	ISO 179/leA	KJ/m ² 4.0
	-30°C	ISO 179/leA	KJ/m ² 2.5
CHARPY Impact Strength (unnotched)	23°C	ISO 179/leA	KJ/m ² No failure
	0°C	ISO 179/leA	KJ/m ² No failure
	-30°C	ISO 179/leA	KJ/m ² 43

Physical Properties

Properties	Test Method	Unit	Value
Density	ASTM D792	G/CM ³	0.91
Melt Flow Index	-	-	-
MFI 190 C / 5 kg	ASTM D1238	G/10 MINUTES	0.4
MFI 230 C / 2.16 kg	ISO R 1133	G/10 MINUTES	0.2
MFI 230 C / 5 kg	DIN 53 735	G/10 MINUTES	0.6



SUPPORT DISTANCE CHART FOR PPR-C TRIPLE LAYER PIPES

Outside Diameter of Pipe (mm)	Temperature In Degree - Support in Cms					
	20	30	40	50	60	70
20	80	75	70	70	65	60
25	85	85	85	80	75	70
32	100	95	95	90	85	75
40	110	110	105	100	95	85
50	125	120	115	110	105	90
63	140	135	130	125	120	105
75	155	150	145	135	130	115
90	170	165	160	155	150	145
110	190	185	180	175	160	165
160	200	200	200	195	180	175
200	225	225	225	225	210	200
250	245	245	245	245	235	235
315	275	275	275	275	265	250
400	295	295	295	295	280	265

"SHK" PPR-C PIPE SELECTION CHART (CFM Vs. PIPE DIA Vs. LENGTH)

FLOW RATE	LENGTH									
	164 FT	328 FT	429 FT	984 FT	1640 FT	2460 FT	3280 FT	4265 FT	5249 FT	6562 FT
CFM	50 Mtr.	100 Mtr.	150 Mtr.	300 Mtr.	500 Mtr.	750 Mtr.	1000 Mtr.	1300 Mtr.	1600 Mtr.	2000 Mtr.
8	1/2"	1/2"	1/2"	1/2"	3/4"	3/4"	3/4"	3/4"	3/4"	1"
18	3/4"	3/4"	3/4"	1"	1"	1 1/4"	1 1/4"	1 1/4"	1 1/4"	1 1/4"
29	3/4"	3/4"	1"	1"	1"	1 1/4"	1 1/4"	1 1/4"	1 1/2"	1 1/2"
49	1"	1 1/4"	1 1/4"	1 1/4"	1 1/4"	1 1/2"	1 1/2"	1 1/2"	2"	2"
59	1 1/4"	1 1/4"	1 1/4"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	2"	2"
88	1 1/4"	1 1/2"	1 1/2"	1 1/2"	2"	2"	2"	2"	2 1/2"	2 1/2"
147	2"	2"	2"	2"	2 1/2"	2 1/2"	2 1/2"	2 1/2"	2 1/2"	2 1/2"
206	2"	2"	2"	2"	2 1/2"	2 1/2"	2 1/2"	3"	3"	3"
294	2 1/2"	2 1/2"	2 1/2"	2 1/2"	2 1/2"	3"	3"	3"	3"	3"
441	2 1/2"	2 1/2"	2 1/2"	3"	3"	3"	3"	4"	4"	4"
589	2 1/2"	2 1/2"	3"	3"	3"	4"	4"	4"	4"	4"
883	3"	3"	3"	4"	4"	4"	4"	6"	6"	6"
1030	3"	3"	3"	4"	4"	4"	4"	6"	6"	6"
1766	4"	4"	4"	4"	6"	6"	6"	6"	6"	6"



ALLOWABLE WORKING PRESSURE FOR PPR

Temperature in C	Years of Service	SDR 11 / PN 10	SDR 7.4 / PN 16	SDR 6 / PN 20
10	1	21.1	33.4	42.1
	5	19.8	31.5	39.7
	10	19.3	30.7	38.6
	25	18.7	29.7	37.4
	50	18.2	28.9	36.4
	100	17.8	28.2	35.5
20	1	18.0	28.5	35.9
	5	16.9	26.8	33.7
	10	16.4	26.1	32.8
	25	15.9	25.2	31.7
	50	15.4	24.5	30.9
	100	15.0	23.9	30.1
30	1	15.3	24.2	30.5
	5	14.3	22.7	28.6
	10	13.9	22.1	27.8
	25	13.4	21.3	26.8
	50	13.0	20.7	26.1
	100	12.7	20.1	25.4
40	1	13.0	20.6	25.9
	5	12.1	19.2	24.2
	10	11.8	18.7	23.5
	25	11.3	18.0	22.6
	50	11.0	17.4	22.0
	100	10.7	16.9	21.4
50	1	11.0	17.4	21.9
	5	10.2	16.2	20.4
	10	9.9	15.7	19.8
	25	9.5	15.1	19.0
	50	9.2	14.7	18.5
	100	9.0	14.2	17.9

Temperature in C	Years of Service	SDR 11 / PN 10	SDR 7.4 / PN 16	SDR 6 / PN 20
60	1	9.2	14.7	18.5
	5	8.6	13.6	17.2
	10	8.3	13.2	16.6
	25	8.0	12.7	16.0
	50	7.7	12.3	15.5
	100	7.8	12.3	15.5
70	1	7.8	11.4	14.4
	5	7.2	11.1	13.9
	10	7.0	11.1	13.9
	25	6.0	9.6	12.1
	50	5.1	8.1	10.2
	100	5.1	8.1	10.2
80	1	6.5	10.3	13.0
	5	5.7	9.1	11.5
	10	4.8	7.7	9.7
	25	3.9	6.2	7.8
95	1	4.6	7.3	9.2
	5	3.1	4.9	6.2
	10	(2.6)	(4.1)	(5.2)

As per DIN 8077:1999-07 allowable working pressure for PPR pipes with
SF = 1.25



THERMAL EXPANSION

A pipe line which is subjected to a variation of temperatures changes its length if it is free to do so. These changes in length are proportional to the unit linear coefficient of thermal expansion.

Pipe in Length (Mtr)	Temperature Difference (-T) 0C							
0.1	0.15	0.30	0.45	0.60	0.75	0.90	1.05	1.20
0.2	0.30	0.60	0.90	1.20	1.50	1.80	2.10	2.40
0.3	0.45	0.90	1.35	4.80	2.25	2.70	3.15	3.60
0.4	0.60	1.20	1.80	2.25	3.00	3.60	4.20	4.80
0.5	0.75	1.50	2.25	3.00	3.75	4.50	5.25	6.00
0.6	0.90	1.80	2.70	3.60	4.50	5.40	6.30	7.20
0.7	1.05	2.10	3.15	4.20	5.25	6.30	7.35	8.40
0.8	1.20	2.40	3.60	4.80	6.00	7.20	8.40	9.60
0.9	1.35	2.70	4.05	5.40	6.75	8.10	9.45	10.80
1.0	1.50	3.00	4.50	6.00	7.50	9.00	10.50	12.00
2.0	3.00	6.00	9.00	12.00	15.00	18.00	21.00	24.00
3.0	4.50	9.00	13.50	18.00	22.50	27.00	31.50	36.00
4.0	6.00	12.00	18.00	24.00	30.00	36.00	42.00	48.00
5.0	7.50	15.00	22.50	30.00	37.50	45.00	52.50	60.00
6.0	9.00	18.00	27.00	36.00	45.00	54.00	63.00	72.00
7.0	10.50	21.00	31.50	42.00	52.50	63.00	73.50	84.00
8.0	12.00	24.00	36.00	48.00	60.00	72.00	84.00	96.00
9.0	13.50	27.00	40.50	54.00	67.50	81.00	94.50	108.00
10.0	15.00	30.00	45.00	60.00	75.00	90.00	105.00	120.00



TECHNICAL & COMMERCIAL COMPARISON

Properties	MS Pipes	CPVC Pipes	PPR Pipes
Service Life	3-5 years	15-20 years	50 years
Food Grade	Poor due to corrosion issues	The solution used for jointing the pipes might contaminate the water. Non-Hygienic in Nature	Hygienic, CFTRI approved- can supply clean water and liquid food
Leakage	High chance	High Chance due to Solution Based Jointing	Negligible chance due to Socket Fusion Jointing
Heat Loss	High	Negligible	Negligible
Thermal Conductivity	Very High (45 W/mK)	Low (0.3 W/mk)	Low (0.23 W/mk)
Insulation Requirement in Chilled Water Supply	More Insulation thickness required due to high thermal conductivity	Pipes not recommended for Chilled Water Supply	1/2 or 1/3rd insulation thickness than MS as thermal conductivity is quite low
Maintenance Cost	High after 3-4 years	High after 5-6 years	Negligible upto 15-20 years
Corrosion Resistance	Nil	Excellent	Excellent
Friction	Very High	Low, approx 4 ft/100 ft	Negligible due to smooth layer, approx 1.5 ft/100 ft
Weight	Very heavy	Very light due to which transportation cost decreases by 3 times	Very light due to which transportation cost decreases by 3 times
Painting Cost	Additionally high for the painting the pipes according to standards	None	None
Young's Modulus	NA	Approx 3275 Mpa which makes the pipe rigid and brittle	Approx 850 Mpa which make the Pipes tough and ductile
Temperature Resistance	Applicable for Higher Temperatures as well	10 Degree Celcius to 80 Degree Celcius (Adhesives used for Joints can be used only upto 60 Degree Celcius)	(-8) to 95 Degree Celcius
CAPEX Costing	30-35% Higher than PPR-C	45-50% Higher Than PPR-C	Very Low CAPEX Costing
OPEX Costing	55-60% Higher than PPR-C because of High Maintenance	20-25% Higher than PPR-C	Very Low OPEX Costing because of Negligible Maintenance
Installation Time	Very High because of Welding Joints and more Man-Power Required	Negligible as Solution based joints	Low because of Socket Fusion Jointing



PRODUCT SPECIFICATION




SHK PPR-C Triple Layer Pipes & Fittings

Type	Size
PN 06 Pipes	200 mm to 400 mm
PN 10 Pipes	32 mm to 315 mm
PN 16 Pipes	20 mm to 315 mm
PN 20 Pipes	20 mm to 315 mm

SHK HDPE Pipes & Fittings (PE100, PE80 & PE63)

Type	Size
PN 2.5 to PN 06 Pipes	40 mm to 450 mm
PN 08 to PN 16 Pipes	20 mm to 315 mm



SHK Pneumato PPR-C Pipes & Fittings

Type	Size
PN 06 Pipes	200 mm to 400 mm
PN 10 Pipes	50 mm to 315 mm
PN 16 Pipes	20 mm to 315 mm
PN 20 Pipes	20 mm to 315 mm

SHK EF Electrofusion HDPE Fittings

Size	63 mm to 315 mm
------	-----------------



PPR-C GREEN FITTINGS

(Size : 20 mm to 400 mm)

Socket



Elbow 90 degree



Elbow 45 degree



Tee



End Cap



Flange Core/Stubend




Reducer



Reducer Tee



PPR-Flange



M/S Powder Coated Flange



Reducing Elbow



Union



Long Bend



F T Saddle



Saddle



Wall Clamp



PPR-C GREEN FITTINGS

(Size : 20 mm to 400 mm)

F T Socket



M T Socket



F T Union



M T Union



F T Elbow



M T Elbow



F T Tee



M T Tee



Gate Valve



Plastic Body Ball Valve



Tank Connector



Long Plug



Cross Tee



PPR-C BLUE FITTINGS

(Size : 20 mm to 400 mm)

Socket



Elbow 90 degree



Elbow 45 degree



Tee



End Cap



Flange Core/Stubend



Reducer



Reducer Tee



Flange



M T Socket



F T Union



M T Union



F T Socket



F T Elbow



M T Elbow



F T Tee



M T Tee



Long Bend



WELDING PROCESS



Cutting

- Cut the pipe at right angle to its axis using burr-free cutter
- Ensure that pipe is free from burrs or cutting chips
- Clean the pipe & fitting perfectly before welding.
- Mark welding depth at the end of pipe



Heating

- Mount the suitable Dies (Socket and Punch) on heating element of welding machine according to the diameter of pipe and fitting to be welded
- Connect the welding machine to 220 Volts A.C. power supply • Select 260 C temperature on the welding machine hermostat • Wait for reaching the required working temperature • Insert the pipe and the fitting in the Dies (i.e. Socket and Punch respectively) by exerting light pressure
- Heat both pipe & fitting as per the size and time given in the following table



Welding

- After heating, quickly insert pipe into the fitting by exerting light pressure
- Any misalignment should be corrected immediately after insertion to avoid any stress in the weld. This type of connection ensures perfect sealing even under the hard working conditions.



Note :

1. Avoid air draughts during welding to avoid stress in the welds.
2. During site welding, keep the welding set at a right angle to the pipe and fitting in order to avoid partial welding.

Pipe Dia. (mm)	Welding Depth (mm)	Heating Time (Sec)	Welding Time (Sec)	Cooling Time (Min)
20	14.50	6	4	2
25	16.00	7	4	2
32	18.00	8	6	4
40	20.50	12	6	4
50	23.50	18	6	4
63	27.50	24	8	6
75	30.00	30	8	6
90	33.00	40	8	6
110	37.00	52	10	8



QUALITY CERTIFICATES



OUR CLIENTS

Sector Ceramic Industries



Application
Multiple



Application
Multiple



Application
Multiple



Application
Multiple



Application
Multiple

Sector Plastic Industries



Application
Multiple



Application
Cooling Tower



Application
Chilled Water Supply



Application
Chilled Water Supply

Sector Government



Application
Multiple Applications



Application
Multiple

Sector Food & Beverages



Application
Cooling Tower & ETP



Application
ETP & Cooling Tower



Application
Multiple Applications

Sector Institutes



Application
Water Supply



Application
Chilled Water Supply



Application
Chilled Water Supply

Sector Chemical Industries



Application
Multiple



Application
Multiple



Application
Multiple



Application
Raw Water and Process Water



Application
Chemical Supply and Raw Water

Sector Foundry



Application
Compressed Air Supply



Application
Compressed Air Supply



Application
Cooling Tower &
Compressed Air



OUR CLIENTS














Sector Pharmaceutical

					
Application Multiple	Application Multiple	Application Cooling Tower	Application Multiple	Application Cooling Tower	Application Multiple
					
Application Multiple	Application Chilled Water Supply	Application Chilled Water Supply	Application Chilled Water Supply	Application Multiple	

Sector Textile

			
Application Multiple	Application Compressed Air Supply	Application Compressed Air Supply	Application Multiple

Sector :Other Clients

					
Application Compressed Air Supply	Application Compressed Air Supply	Application Chilled Water Supply	Application Multiple	Application Compressed Air Supply	Application Chilled Water Supply
					
Application Chilled Water SupplyV	Application Multiple	Application Multiple	Application Chilled Water Supply	Application Chilled Water Supply	Application Multiple
					
Application Chilled Water Supply					



